




Ekzijans Ranjanman Aparèy Kwizin Komèsyal




An akò ak edisyon aktyèl NFPA 17A: Estanda pou sistèm ekstenktè pwodwi chimik ki imid yo – ekipman kwizin ki ka deplase yo dwe ranje on jan pou asire ke yo byen pozisyone pa rapò ak aparèy ekstenktè pandan manje ap kwit.

An plis, an akò avek edisyon aktyèl NFPA 96: Estanda pou kontwòl vantilasyon ak Pwoteksyon kont Ensandi pou operasyon manje komèsyal- “Yon metòd ki apwouve dwe bay pou asire ke aparèy la retounen a yon lokal disay ki apwouve”

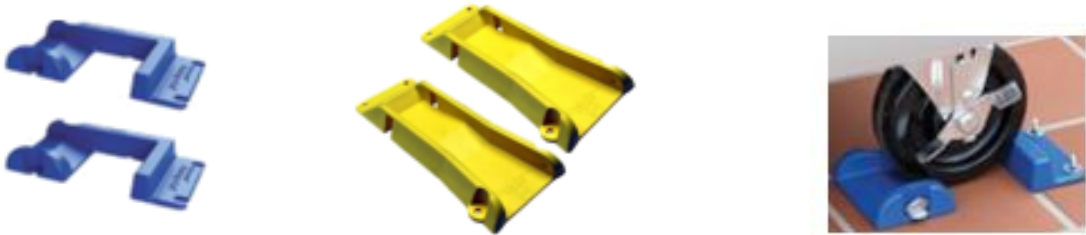

Menm si aparèy kwizin nan ki anba sistèm sipresyon an sou wou oswa pye, ekipmanan dwe anchene oswa kable nan yon mi an ka si ekipman ta rale lwen mi a - chenn nan oswa kab la ap anpeche liy gaz la detache.

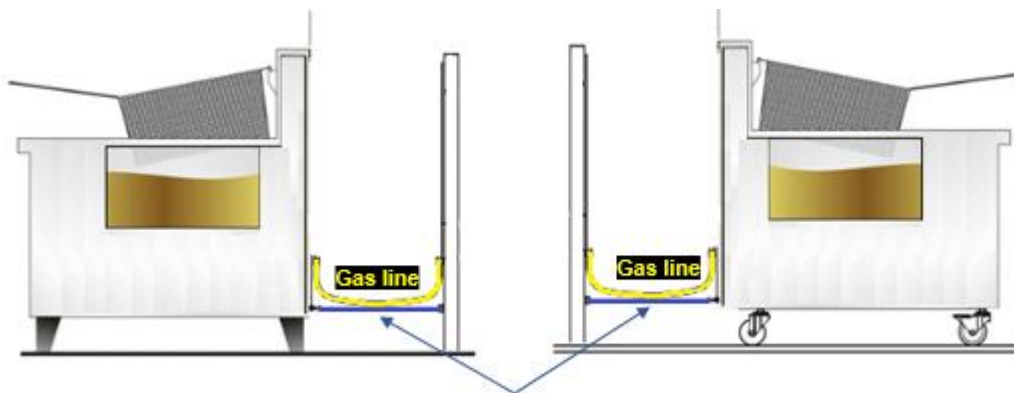

Chenn/Kab dwe pi kout ke liy gaz la

