



WIND INFORMATION – 2004 F.B.C. (w 2007 REVISIONS)	
BASIC WIND SPEED:	140 M.P.H. 3 SECOND GUST
BASIC VELOCITY PRESSURE:	29 P.S.F.
OCCUPANCY USE/TYPE:	STORAGE
IMPORTANCE FACTOR:	0.77
EXPOSURE CATEGORY:	B
INTERNAL PRESSURE COEFFICIENT:	CH.16 F.B.C. ENCLOSED IMPACT-PROTECTED OPENINGS
COMPONENTS & CLADDING:	PER TABLE 16092B
M.W.F.R.S.–ROOF DESIGN PRESSURE:	PER TABLE 1606.2.A:26.0 P.S.F. UPLIFT
TOTAL ROOF DEAD LOAD:	17 P.S.F. BEARING
TOTAL ROOF LIVE LOAD:	30 P.S.F. BEARING 10 P.S.F. BOTTOM CHORD
MEAN ROOF HEIGHT:	LESS THAN 20 FT.
SOIL BEARING CAPACITY;	2500 P.S.F
APPROVED PRESCRIPTIVE DESIGN FOR PERMITTING IN PALM BEACH COUNTY PER THESE DETAILS ONLY BCAB ACTION MAR 18, 2009	

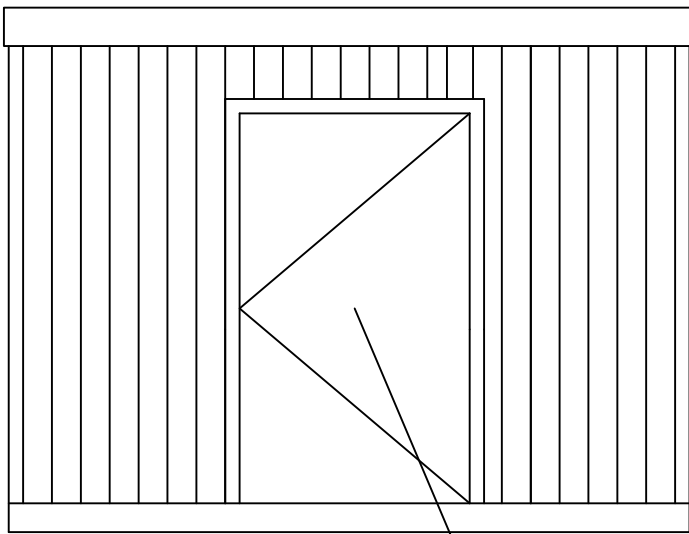

FRONT ELEVATION

N.T.S.

+33.9 PSF
-43.1 PSF

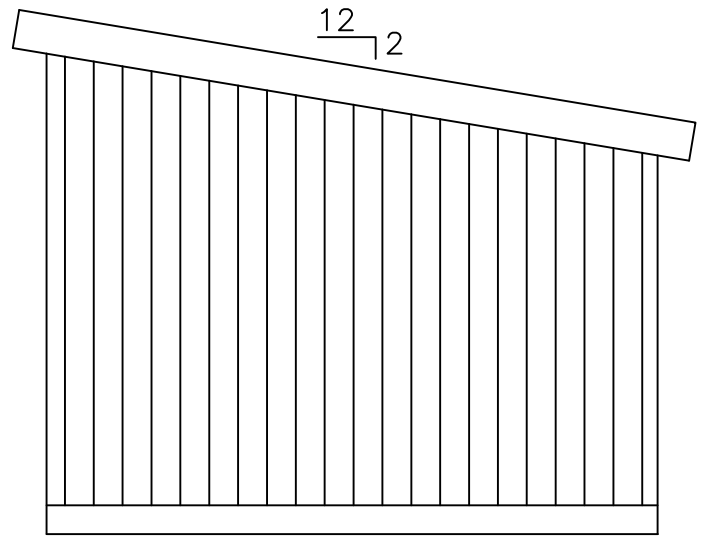

RIGHT SIDE ELEVATION

N.T.S.


**Palm Beach County
Building Code Advisory Board
11-07**

YARD STORAGE BUILDING

11' - 8" * WIDE X 10' - 7" DEEP

SCALE 3/8"=1'-0"

A-1

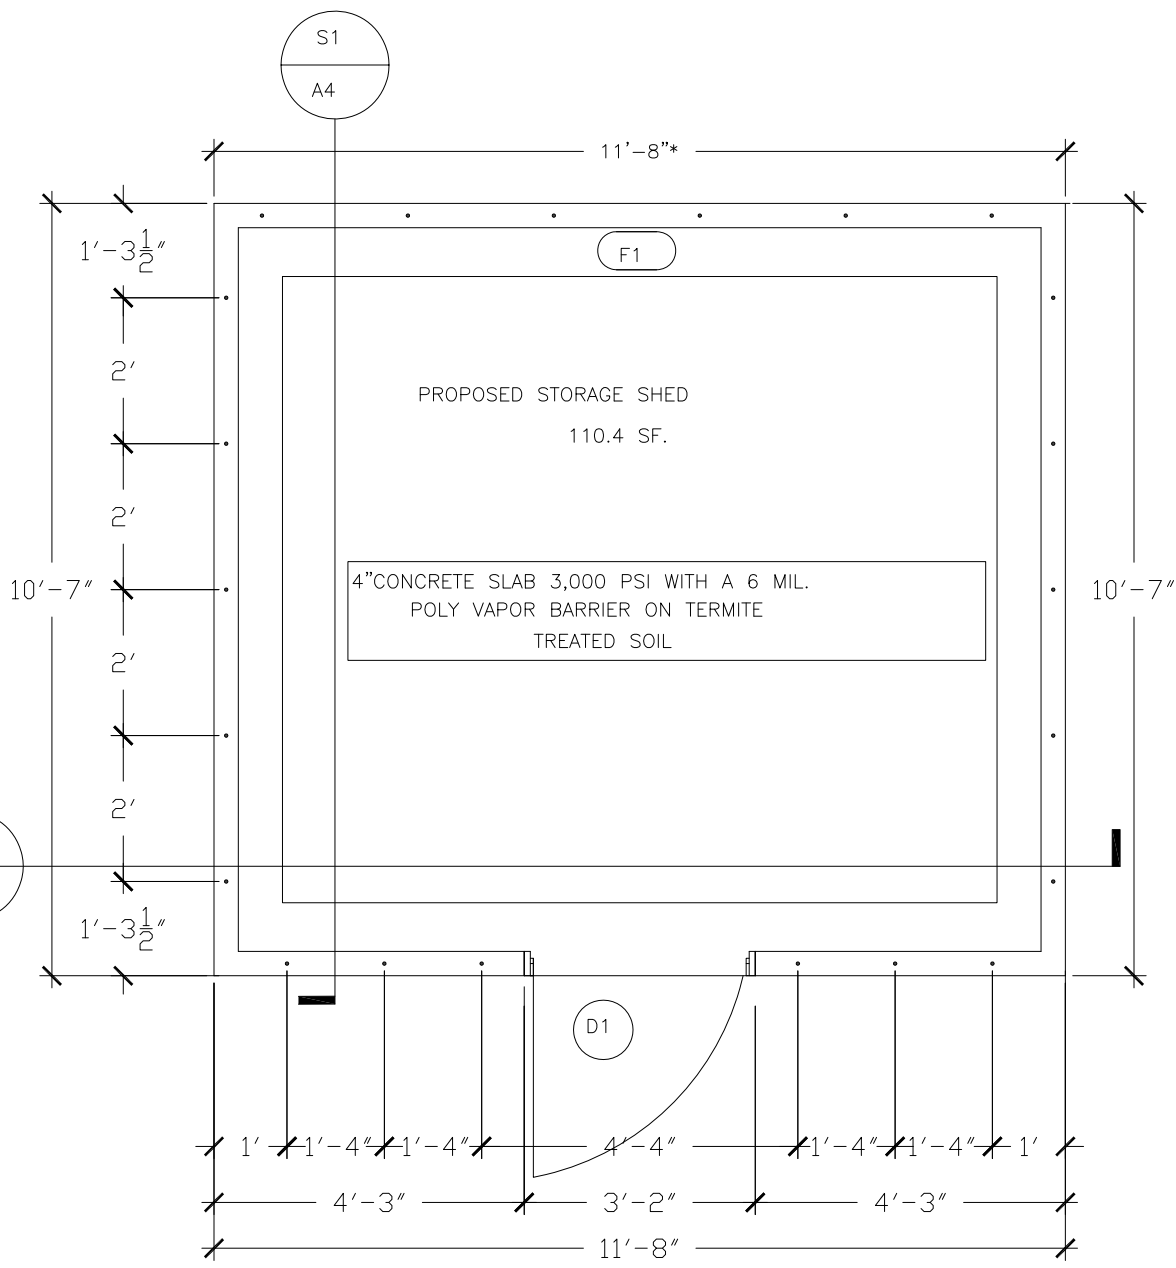


FLOOR PLAN

3/8"=1"

FOUNDATION SCHEDULE

16"X14" MONOLITHIC SLAB
W 2 #5

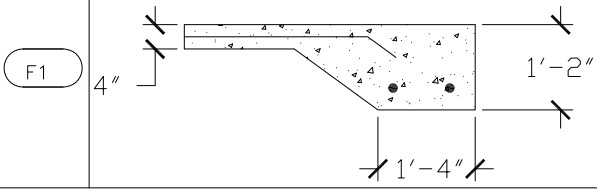

WINDOW & DOOR SCHEDULE

ID	WIDTH	HEIGHT	TYPE	CONS
D1	3'-0"	6'-8"	SINGLE	ALUM

* NOTE: 2'-0" INCREMENTS MAY BE ADDED
UP TO 19'-8" MAX

Palm Beach County
Building Code Advisory Board
11-07


YARD STORAGE BUILDING

11' - 8"* WIDE X 10' - 7" DEEP

FOUNDATION PLAN

SCALE 3/8"=1'-0"

A-2

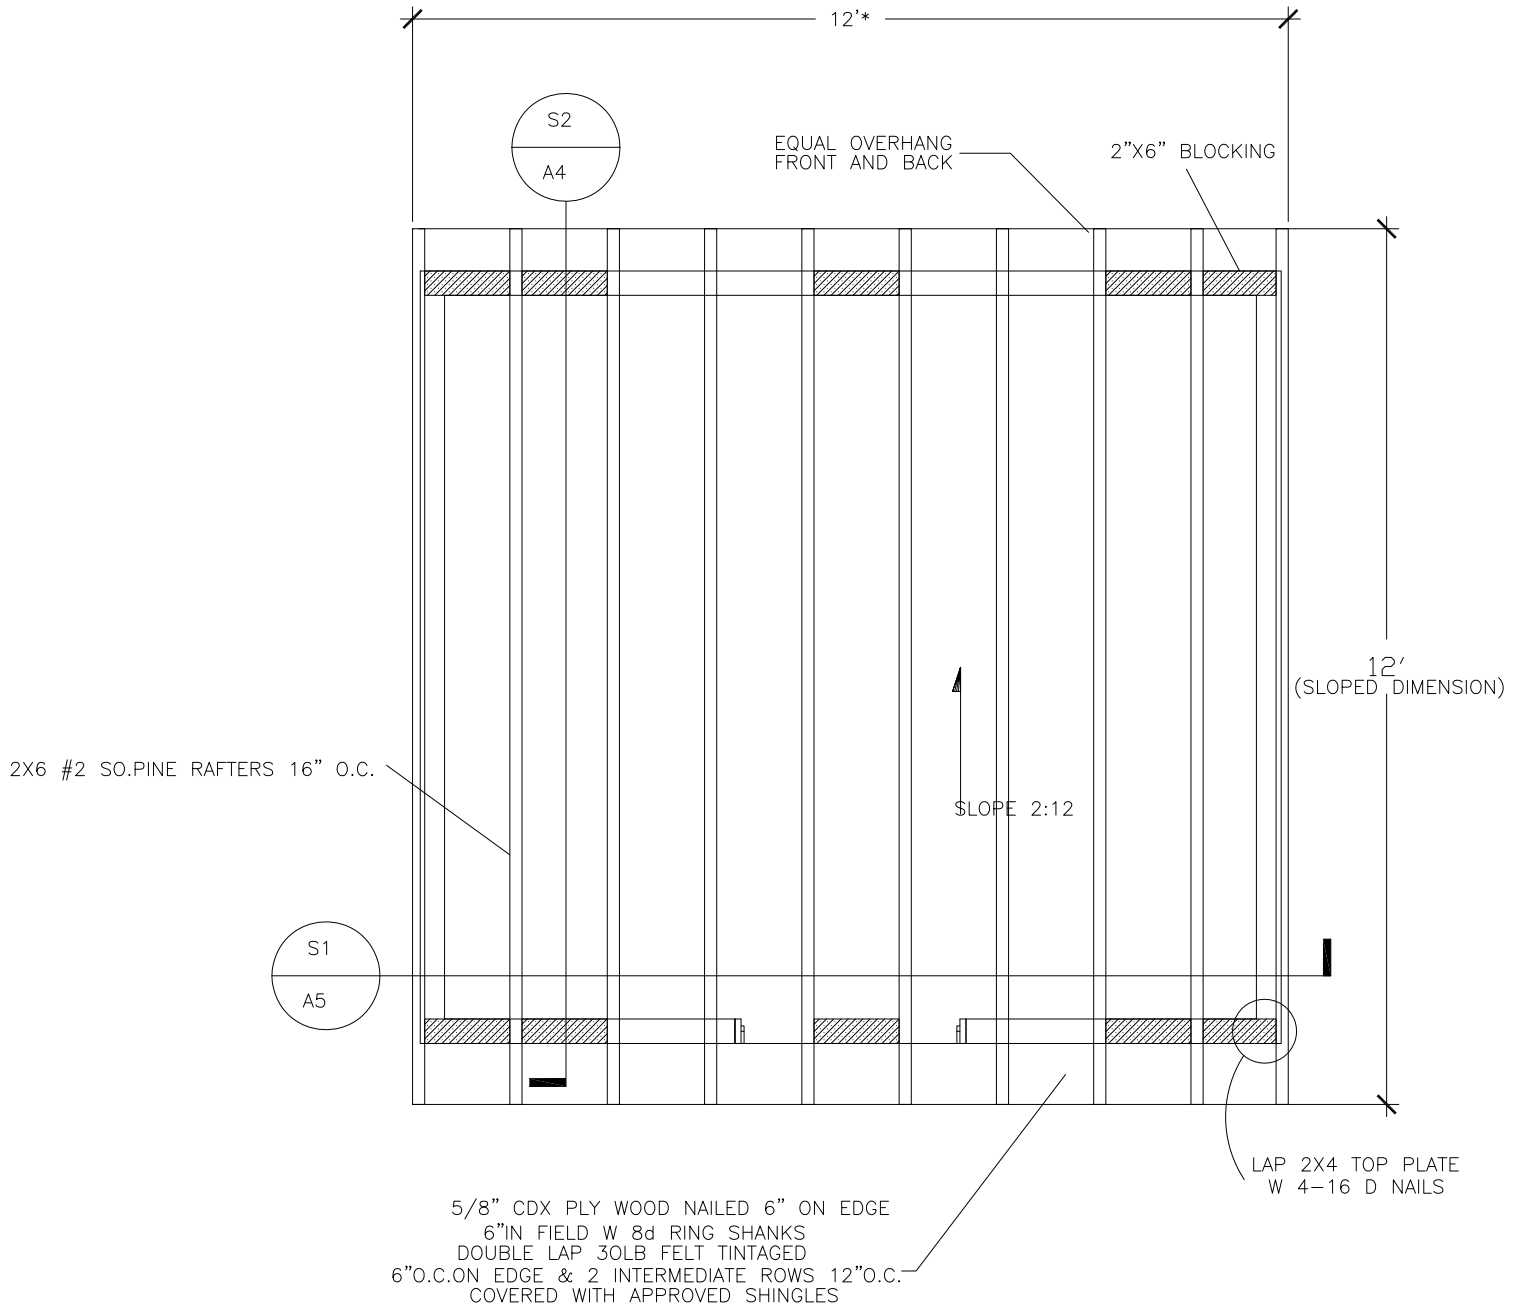

ROOF PLAN

3/8"=1"

Palm Beach County
Building Code Advisory Board
11-07


YARD STORAGE BUILDING

11' - 8"* WIDE X 10' - 7" DEEP

ROOF FRAMING PLAN

SCALE 3/8"=1'-0"

A-3

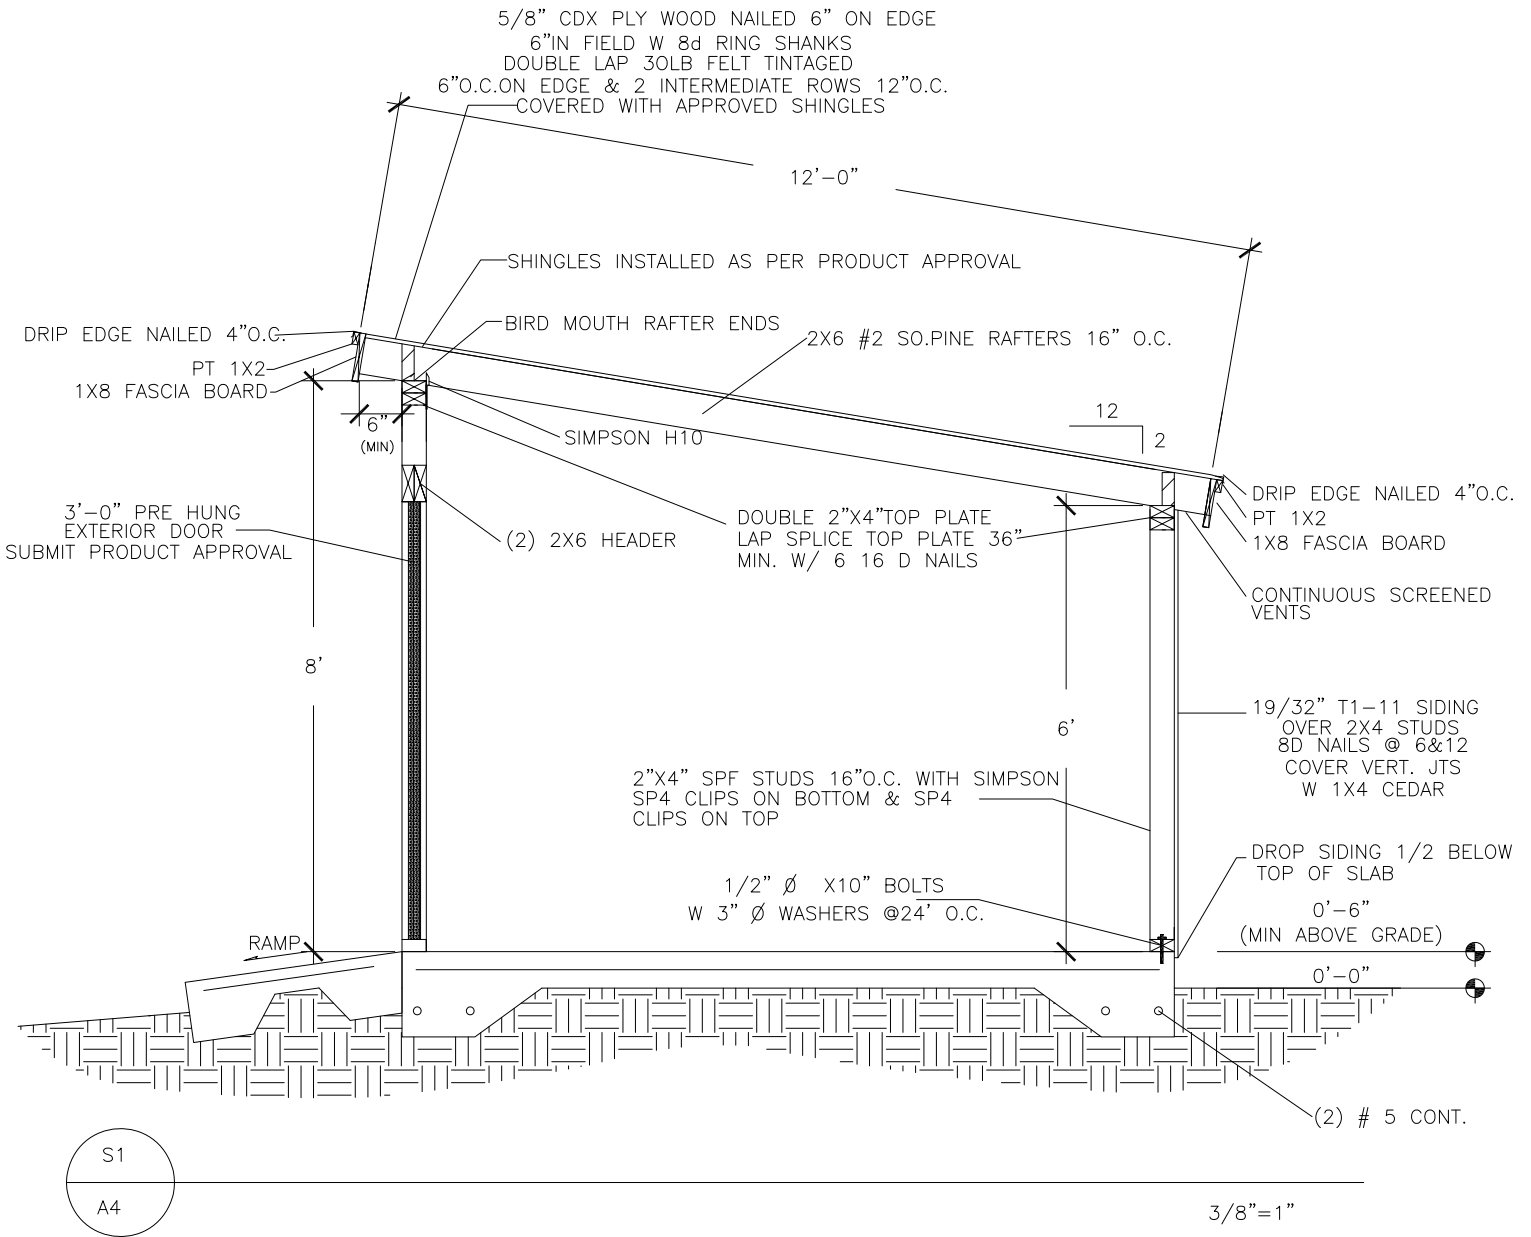

Palm Beach County
Building Code Advisory Board
11-07


YARD STORAGE BUILDING

11' - 8" * WIDE X 10' - 7" DEEP


SECTION

SCALE 3/8" = 1'-0"

A-4

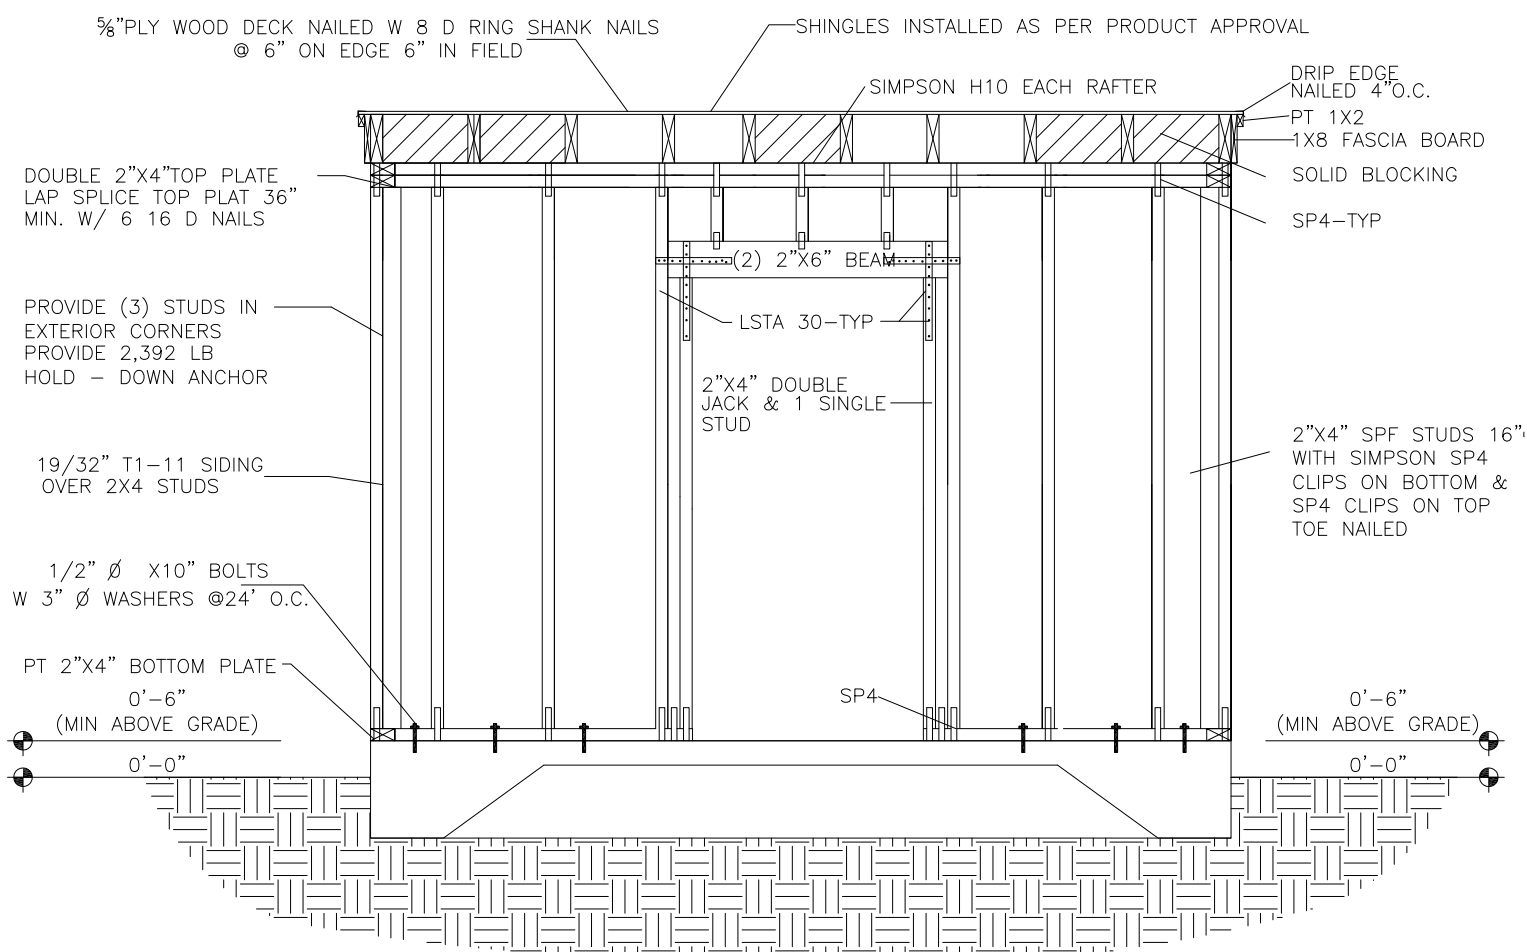

S2
A5

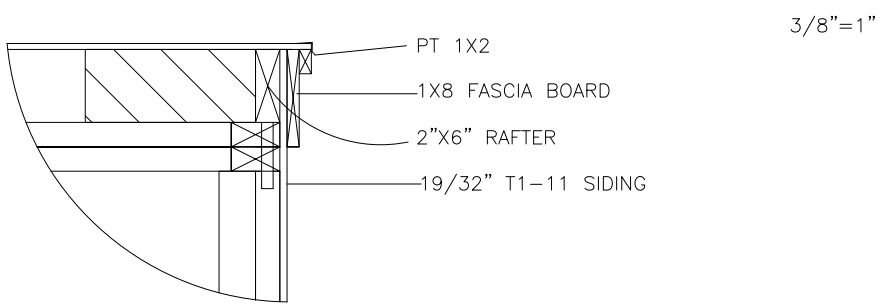

RAKE DETAIL

NTS

Palm Beach County Building Code Advisory Board 11-07	YARD STORAGE BUILDING 11' - 8" WIDE X 10' - 7" DEEP	
	SECTION	
	SCALE 3/8"=1'-0"	A-5

MAJOR MATERIAL LIST

FORMS

4- 2X12X12
5- 2X4X12
26-2X4 STAKES
120 SF 6 MIL VISQUEEN

RE-BAR

4#5 @ 10'-4"
4#5 @ 11'-6"
8#5 @ 5'-0" 90° CORNER BARS
20- 16" W.P.B. FOOTING CHAIRS

WALL FRAMING

48- 2X4X8
8- 2X4X12
4- 2X4X12 PT
1- 2X6X8
12- 5/8"X4X8 3/4" T-111
11- 1X4X10 RS CEDAR

28-1/2" Ø X6" WEDGE ANCHORS
1- ROLL 30# FELT
1- 3-0 X6'8" RH OUT SWING
(EXTERIOR DOOR)
6- SIMPSON LSTA 30
90- SIMPSON SP4 CLIPS

ROOF

14- 2X6X12 SYP#2
4- 1X8X14 RS CEDAR
5- 1X2X10 PT
5- 5/8X4X8 CDX PLYWOOD

20- SIMPSON H-10
1 ROLL 30# FELT
60' 2X2 DRIP EDGE
2 SQUARES ASPHALT SHINGLES

* NOTES: (1) INCREASED QUANTITY REQUIRED
FOR BUILDINGS OVER 11'-8"
WIDE.

(2) FASTENERS, SEALANTS, DOOR HARDWARE AND
OTHER MISCELLANEOUS MATERIALS REQUIRED.

Palm Beach County
Building Code Advisory Board
11-07

YARD STORAGE BUILDING

11' - 8"* WIDE X 10' - 7" DEEP

MATERIAL LIST

SCALE 3/8"=1'-0"

A-6