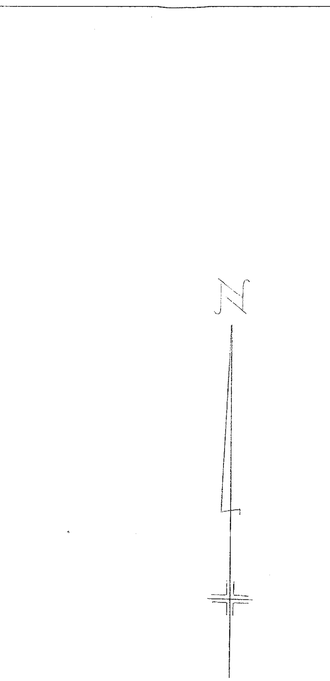

Location Map

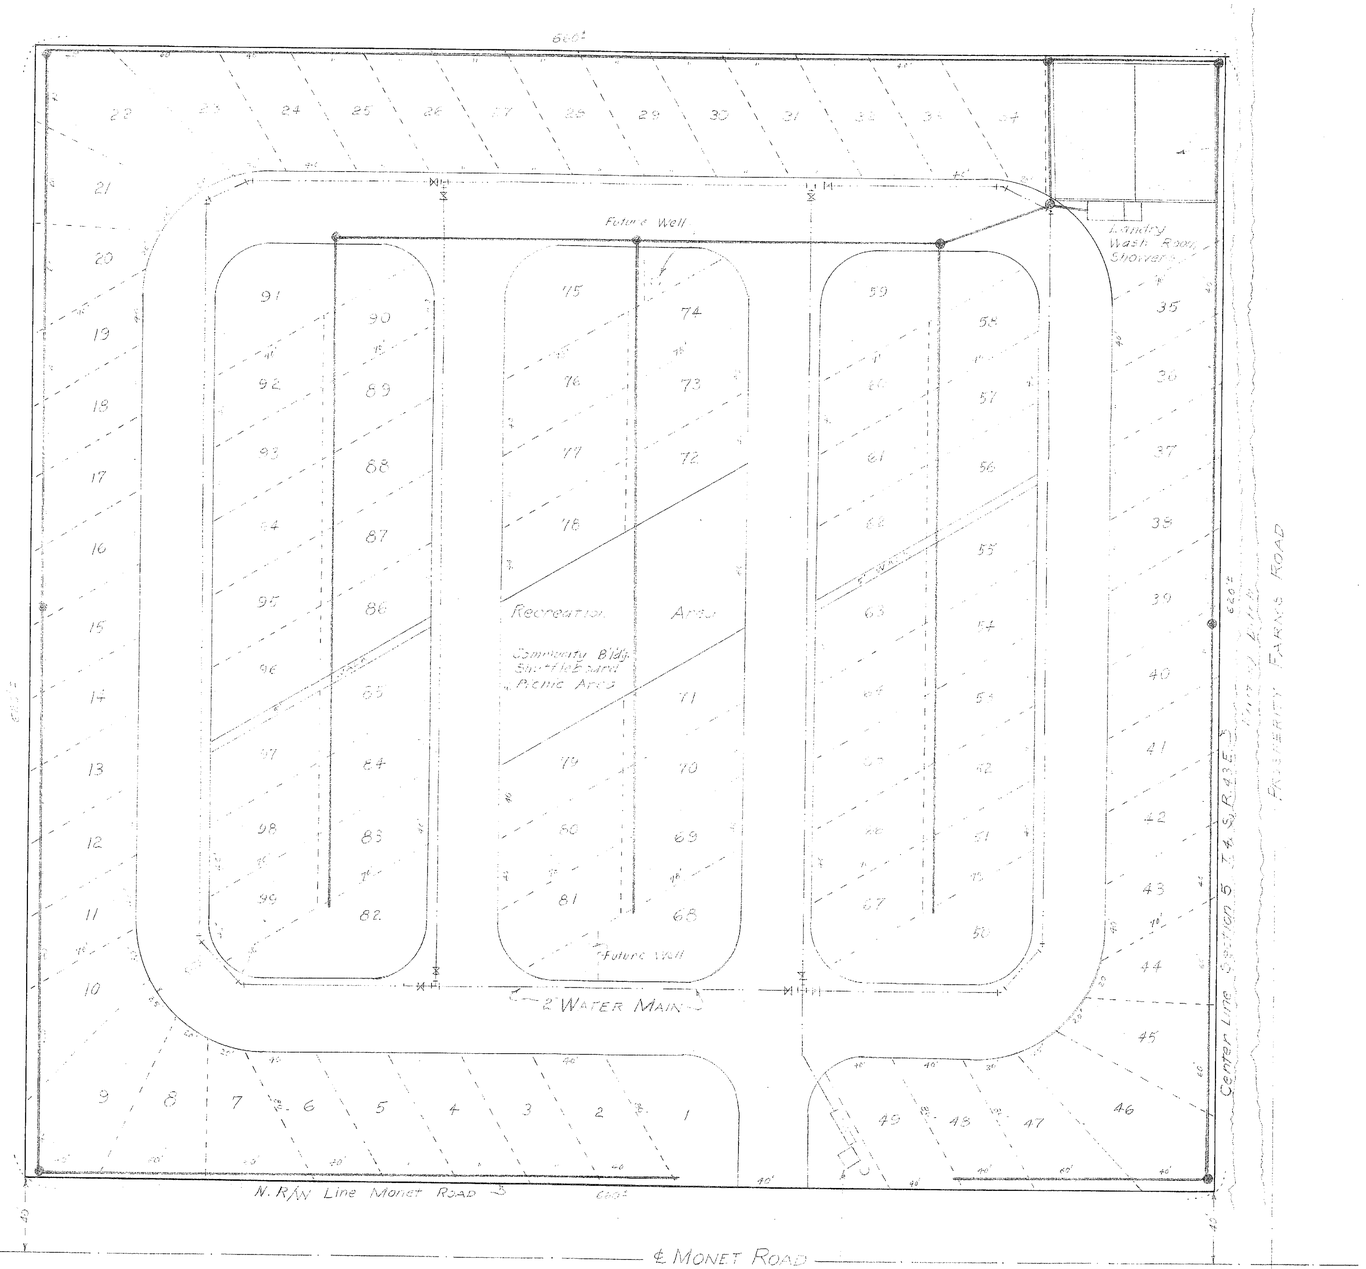

Legend

Sewer Line with Manhole
Water Line
Lot Lines

Sewage Treatment

Septic Tank 10'×20'×5' (1500 Gal. L.C.)
Dosing Chamber 10'×10'×5' (3750 " " .)
Closed Sand Filter 2 - 45'×135' Beds
Sump Pumps: 2 - 3 H.P. - 375 g.p.m. pumps
(Use: Deming N-602-F Duplex or equal)

Notes:

All Roads 40'; - Paving 20'
Exact dimensions dependent on Survey
Center line Radius on all corners 50'
Set Back on all Lots - 15' Front, 10' Rear, 5' Side

Water Treatment

1 - 1850 Gal. Storage Tank
1 - Wallace & Tiernan Series A-677 Solution Feed Chlorinator
2 - 2 H.P. Motor - Pumps (Deming 4963 - SWR or equal)
1 ½ H.P. Gas Driven Pump (Deming 1890-G or equal)
1 ½ H.P. Air Compressor

Proposd Site Plan For MONET ACRES

SE¼, SE¼, SW¼,
Section 5, Twp. 42 S, Rge. 43 E.

JOHN P. DAVIS & ASSOCIATES
REGISTERED LAND SURVEYOR
WEST PALM BEACH, FLORIDA

FIELD:	SCALE: 1" = 40'
OFFICE:	
DR. BY Murray	DATE: Jan. '58
FIELD BK.	