PALM BEACH COUNTY **BOARD OF COUNTY COMMISSIONERS** AGENDA ITEM SUMMARY

Meeting Date:

February ¥, 2014

Consent [X] Public Hearing [] Regular []

Department:

Water Utilities Department

I. EXECUTIVE BRIEF

Motion and Title: Staff recommends motion to approve: a Contract with MWH Constructors, Inc. for Water Treatment Plant No. 2 (WTP 2) Filter Replacement in the amount of \$13,896,000.

Summary: On November 1, 2013, five (5) bids were received for the WTP 2 Filter Replacement Project to replace the existing filter system and to construct a backwash recovery system. The existing steel fabricated filters were installed as a developer-constructed water treatment facility in 1973 (Phase 1) and 1981 (Phase 2), and are nearing the end of their useful life. The replacement filters will be concrete construction to house the filter media which will provide a longer useful life. The addition of backwash recovery will conserve water resources and reduce operating costs. The low bidder, MWH Constructors, Inc., is the lowest responsive, responsible bidder in the amount of \$13,896,000. The Small Business Enterprise (SBE) participation goal established by the SBE Ordinance (R2002-0064) is 15% overall. MWH Constructors, Inc. has met the goal with a participation of 17.83% overall. MWH Constructors, Inc. is a Palm Beach County company. This project is included in the FY13-14 Capital Improvement plan adopted by the Board of County Commissioners. (WUD Project No. 12-066) District 2 (JM)

Background and Justification: On December 4, 2012, the Palm Beach County Board of County Commissioners approved Consultant Services Authorization No. 8 with Carollo Engineers, Inc. for design of the replacement filters and backwash recovery system (R-2012-1817). The existing 14 media filter units at WTP 2 are over 30 years old and are reaching the end of their useful life. The addition of filter backwash recovery has a payback of less than five (5) years and will conserve water resources. On November 1, 2013, five (5) bids were received for the construction of the project. Staff and consultants have reviewed the bids and recommend award to MWH Constructors, Inc. as the lowest responsive, responsible bidder. The summary of bid irregularities for all the proposals is detailed in Attachment 5. The irregularities provide no competitive advantage. There is no protest associated with this item.

Attachments:

- Two (2) Original Contracts
 Location Map
- 3. Engineer's Recommendation & Bid Tabulation Sheet
- 4. SBE Compliance Review
- 5. List of Minor Bid Irregularities

Recommended By:	Berl Beamle	1/22/14
	Department Director	Date
Approved By:	ander	(31/14
<u> </u>	Assistant County Administrate	or \ \ Date

II. FISCAL IMPACT ANALYSIS

A. Five Year Summary of Fiscal Impact:

Fiscal Years	2014	2015	2016	2017	2018
Capital Expenditures External Revenues Program Income (County) In-Kind Match County	\$13,896,000./ <u>0</u> <u>0</u> <u>0</u>	<u>0</u> <u>0</u> <u>0</u>	<u>0</u> <u>0</u> <u>0</u> <u>0</u>	<u>0</u> <u>0</u> <u>0</u> <u>0</u>	<u>0</u> <u>0</u> <u>0</u>
NET FISCAL IMPACT	\$13,896,000	<u>0</u>	<u>0</u>	<u>0</u>	<u>0</u>
# ADDITIONAL FTE POSITIONS (Cumulative)	<u>0</u>	<u>0</u>	<u>0</u>	<u>0</u>	<u>0</u>

Budget Account No.:	Fund <u>4011</u>	Dept	<u>721</u>	Unit	W002	Object	<u>6541</u>	
Is Item Included in Curre	ent Budget?	Υ	es X	No				
		Repo	orting Ca	ategory	N/A			

B.	Recommended	Sources	of	Funds/Summary	of	Fiscal	Impact:
							-

One (1) time capital expenditure from user fees with balances brought forward.

C.	Department Fiscal Review:	Delira m West	

III. REVIEW COMMENTS

A. OFMB Fiscal and/or Contract Development and Control Comments:

C. Other Department Review:

В.


Purchasing Department Director

This summary is not to be used as a basis for payment.

ATTACHMENT NO. 2



Palm Beach County
Water Utilities
Department
Service Area (SA) and
Major Facilities

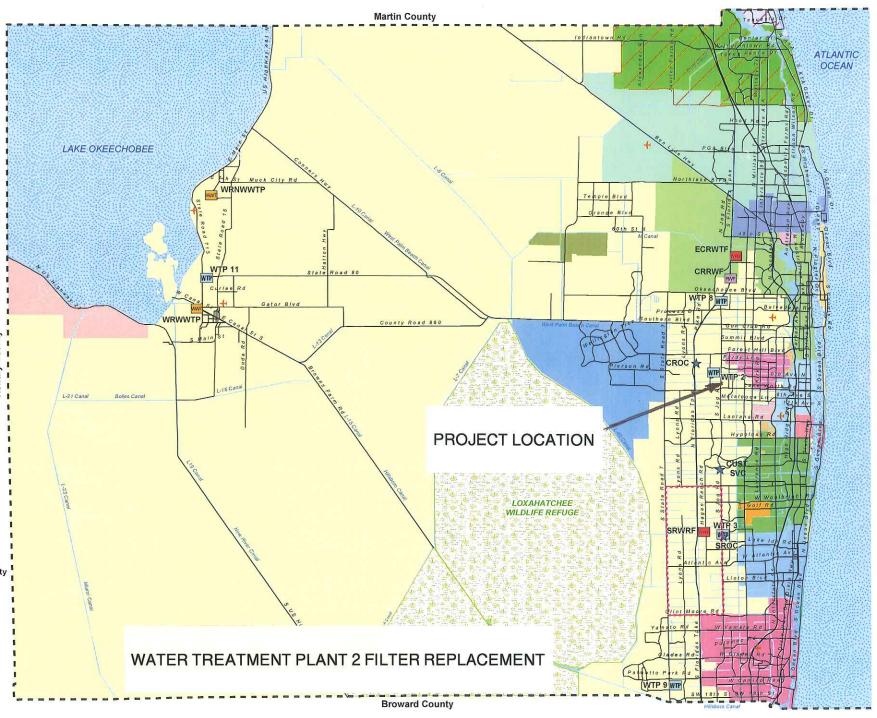

Legend



WIP Water Treatment Plant

ME Reclamation Facility

Wastewater Reclamation Facility

Wastewater Treatment Plant

--- Mandatory Reclaimed SA

= = Palm Beach County Limits

P.B.C.W.U.D. Service Area



Inter-Office Memorandum

Palm Beach County



Water Utilities Department

11-26-13P05:47 RCVD

DATE:

November 26, 2013

TO:

Bevin A. Beaudet, P.E.

Director

FROM:

Maurice Tobon, P.E.

Director of Engineering

RE:

Notice of Award Recommendation

WTP 2 Filter Replacement Project No. WUD 12-066

1-6. An evaluation of the low bid is as follows:

The bid opening for the above referenced project was held on Friday, November 1, 2013. Proposals were received from five (5) contractors. The complete Bid Tabulation is attached. The engineer's opinion of probable construction cost was \$15,152,500 for Bid Item Numbers

1. The Bid Form provided in the Contract Documents was properly executed.

- 2. Bid security equal to 5% of the total base bid was enclosed with the bid.
- The contractor holds a valid state contractor's license. A copy of the license information is included.
- 4. MWH Constructors, Inc. has Local Preference and has submitted the required documentation (see attached Palm Beach County Tax Collector receipt).
- 5. SBE-M/WBE Schedules #1 and #2 were provided. The low bid submitted did not met the 15% SBE goal established under the SBE Ordinance, (see attached SBE-M/WBE compliance review stating MWH Constructors, Inc. has 17.83% SBE participation).
- 6. The County Attorney has reviewed the bid and Bid Review Comments for MWH Constructors, Inc. and determined that the bid is responsive (see attached Bid Review Comments and email).

As a result of this evaluation we recommend MWH Constructors, Inc. as the successful, responsive, low bidder. Contract award is recommended to the lowest responsive bidder in the amount not to exceed \$13,896,000.00 subject to formal approval by the Board of County Commissioners. A copy of this notice has been emailed to all bidders and is posted at the bid opening location and will be left there for a minimum of five (5) business days.

 Brian Shields, P.E. Deputy Director Stephen McGrew, P.E. Plant Design Manager

Maurice Tobon, P.E. Director of Engineering Craig C. Williams, Assistant Director of Finance & Administration



STATE OF FLORIDA

DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION

CONSTRUCTION INDUSTRY LICENSING BOARD 1940 NORTH MONROE STREET TALLAHASSES FL 32399-0783

(850) 487-1395

LAVOLE, BLAIR MICHAEL MWH CONSTRUCTORS INC 370 INTERLOCKEN BLVD STE 300 BROOMFIELD CO 80021

Congratulations: With this license you become one of the nearly one million Floridans Ilcensed by the Department of Business and Professional Regulation. Our professionals and businesses range from erchitects to yethit brokers, from boxers to barbeque restaurants, and they keep Florida's economy strong.

Every day we work to improve the way we do business in order to serve you batter. For information about our services, please log onto www.myfloridalicense.com. There you can find more information about our divisions and the regulations that impact you, subscribe to department newsletters and learn more about the Department's initiatives.

Our mission at the Department is: License Efficiently, Regulate Fairly. We constantly strive to serve you better so that you can serve your customers. Thank you for doing business in Florida, and congratulations on your new licensal



STATE OF FLORIDA ACT E 11.7.5
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION AC# 6 N. 7-8 1/6

CGC058999 05/31/12 118195768

CERTIFIED GENERAL CONTRACTOR LAVOIE, BLAIR MICHAEL MAH CONSTRUCTORS INC

IS CERTIFIED under the provisions of th. 489 Defration date: AUO 31, 2014 L12053101683

DETACH HERE

C#6147346

OUIS/ONO/11/00/19/00/STATE OF FLORIDA

DEPARTMENT OF EUGINESS AND PROFESSIONAL REGULATION CONSTRUCTION INDUSTRY LICENSING BOARD

SEQ#112053101682

BAYCH NUMBER DICENSE NER

05/31/2012 118195768 C.The GENERAL CONTRACTOR
Named below IS CERTIFIED
Under the provisions of Chapter 489 FS.
Expiration date: AUG 31, 2014 LAVOIE, BLAIR MICHAEL WH CONSTRUCTORS INC 370 INTERLOCKEN BLVD SUITE 300 BROOMFIELD

CO 80021

RICK SCOTT GOVERNOR

nton are an engruence my Laski



ANNA M. GANNON

correction Rate Rand County

P.O. Box 3383, West Paint Beach, FL 33402-3383

rowspectax com Tel: (E61) 356-2284

"LOCATED AT"

100 South DIXIE HWY WEST PALM BEACH, FL 33401

Serving you.

CENTRACADAN RECEDENTAL PROGRAMMOS CONTRACTOR TANGEL GENERAL CONTRACTOR CYAIR LAVORBLARIECIAEL

This document is valid only when recoiped by the Tex Colories's Office.

STATE OF FLORIDA
PALM BEACH COUNTY
2013/2014 LOCAL BUSINESS TAX RECEIPT

MWH CONSTRUCTORS INC MWH CONSTRUCTORS INC 370 INTERLOCKEN BLYD STE 300 BROOMFIELD, CO 50021 արարդությունը արդակության անում

LBTR Number: 201358433 EXPIRES: SEPTEMBER 30, 2014

This receipt grants the privilege of engaging in or namening any tenthese profession or ecoopation with its price of the profession and MUST be conspicuously displayed in the place of business and in such a namening as to be open to displayed in the profession.



Office of Small Business Assistance

50 South Military Trail, Suite 202 West Palm Beach, FL 33415 (561) 616-6840 Fax: (561) 616-6850 www.pbcgov.com/osba

Palm Beach County Board of County Commissioners

Steven L. Abrams, Mayor Priscilla A. Taylor, Vice Mayor

Hai R. Valeche

Paulette Burdick

Shelley Vana

Mary Lou Berger

Jess R. Santamaria

County Administrator

· Robert Weisman

"An Equal Opportunity Affirmative Action Employer"

printed on recycled paper

DATE:

November 18, 2013

TO:

Tish Fox

WUD Engineering Division

THROUGH:

Allen Gray, Manager

Office of Small Business

FROM:

xicia Wilhelm, Small Business Development

pècialist II

SUBJECT:

Compliance Review on Project No. WUD 12-066 Water Treatment Plant 2 Filter Replacement

The following is a Compliance Review of SBE participation on the above-mentioned project.

Low Bidder:

MWH Constructors, Inc.

100 S. Dixie Hwy Ste 300 West Palm Beach, FL 33401

Phone:

Bid Opening:

Goal Achieved:

954-605-6711 November 1, 2013

Bid Amount:

\$13,896,000.00 15% Overall

Goal:

17.83%

SBE Participation:

(BL)Brown & Brown

\$ 1,563,000.00

11.25%

(WB) Dejong Construction

915,000.00

6.58%

\$2,478,000.00

17.83%



Page 2.

2nd Low Bidder:

Kerlin Florida LLC

3125 W. Commercial Blvd Ste 200

Ft Lauderdale, FL 33309

Phone:

954-739-8100

Bid Amount:

\$13,986,399.00

Goal:

15% Overall

Goal Achieved:

14.87%

SBE Participation:

(SB) Proshell Construction \$2,081,000.00

3rd Low Bidder:

Poole & Kent of Fl.

801 Northpoint Parkway Ste 64

West Palm Beach, Fl. 33407

Phone:

Bid Amount:

305-325-1930 \$14,015,000.00

Goal:

15% Overall

Goal Achieved:

15.9%

SBE Participation:

(SB) Coral Steel	\$	600,700.00		4.28	왕
(SB) Airtex	\$	80,000.00		.57	용
(SB) F1. Blacktop	\$	150,000.00		1.07	용
(BL) Brown & Brown	\$1	.400.000.00	윶	9.98	왕



Page 3.

EVALUATION:

The Low Bidder, MWH Constructors, Inc. has met the SBE goal for this project.

The second low bidder, Kerlin Florida, LLC did not meet the SBE goal for this project.

The third low bidder, Poole & Kent of Fl., has met the SBE goal and is within the range of ranking of responsive bidders.

c: Allen Gray, Manager OSBA Tammy Fields, Chief Assistant County Attorney

Inter-Office Memorandum

Palm Beach County



Water Utilities Department

DATE:

November 6, 2013

TO:

Michael W. Jones, Assistant County Attorney

Palm Beach County Attorney

FROM:

Tish Fox,

Water Utilities Dept., Engineering Division

RE:

Water Treatment Plant 2 Filter Replacement

FILE:

Project No. WUD 12-066

We have reviewed the three (3) lowest bids received for Water Treatment Plant 2 Filter Replacement. Please review the errors, omissions and/or irregularities that have been noted on the Bid Review Comments and provide your recommendations.

The following items are attached:

Formal Bid Checklist

- **Draft Bid Review Comments**
- 2. 3. **Bid Tabulation**
- 4_ Bid Documents for the three (3) lowest bidders
- Contract documents

If you need additional information, please call me at (561) 493-6118.

Thank you. Attachments

Brian Shields, P.E. Deputy Director, WUD Maurice Tobon, P.E., Director of Engineering, WUD

Bid Review Comments

WTP 2 Filter Replacement

WUD 12-066

The three (3) lowest bids of the five (5) received for the WTP 2 Filter Replacement have been reviewed. The errors, omissions or irregularities found have been noted below.

MWH Constructors, Inc.

 Attachment No. 4 - Div 11 / Transfer & Backwash Pump Supplier - the transfer pump was not stated.

Kirlin Florida, LLC

Poole & Kent Company of Florida

 Attachment No. 4 - Div 11 / Transfer & Backwash Pump Supplier - the backwash recovery pump was not stated.

WUD 12-066 Page I of 1

BID TABULATION SHEET

TITLE

Water Treatment Plant #2 Filter Replacement

BID#

12-066

PAGE 1 OF 1

		dinal tors, Inc.		LORIDA, LC	MWH CONSTRUCTORS, INC		POOLE COMPAN	& KENT NY OF FL	WHARTON-SMITH, INC.		
BASE BID	\$ 154	97,500.00	\$13,980	<u>4,399.00</u>	\$ 13,89	6,000.00	\$14,015,000.0		\$15,48	<u>7,000.00</u>	
Addendum #1- #3	\odot	N	(Y)	N	Y	N	Y	N	Ŷ	N	
Attachment #1 BID BOND	Y	. N	Y	N	Ŷ	N	Y	N	(Y)	N	
Attachment #2 SBE-M/WBE Schedules	Y	N	(Y)	N	Ŷ	N	Y	N	Y	N	
Attachment #3 Certification of Business Location	Ŷ	N	Y	N	Ŷ	N	Ŷ	N	(Y)	N	
Attachment #4 List of Subcontractors	Y	N	Y	N	Ŷ	N	(¥)	N	(Y)	N	
Attachment #5 Trench Safety	Ŷ	N	Y	N	Ŷ	N	(<	N	Y	N	

BIDS PICKED UP BY

ENGINEER

DATE 11/1/13

PROJECT: WTP 2 Filter Replacement PROJECT No.: WUD 12-066 PROJECT MANAGER: Tish Fox		Constru Inc. ,896,00	·		n Florida 3,986,39	-	Poole & Kent Company of Florida \$14,015,000.00			
DATE: 11/6/2013	Ψ.0	-,		Ψ.	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	0.00	ψ 1 -1 ,0 1-2,000.00			
Bid Tabulation	Yes	No	N/A	Yes	No	N/A	Yes	No	N/A	
Is the Bid Tabulation correct	X		ļ	X		Ĺi	X	<u></u>	<u> </u>	
Bid Evaluation Is the bid unbalanced		X			Х	T1	<u></u>	х	I	
Is the Bidder Responsive	L	_l	اـــــــــــــــــــــــــــــــــــــ				L			
Was the bid received, opened and accepted at the time and place set forth in the invitation for bids	Х			×	***************************************		х	:		
Bid package contains all required Attachments and Correct Bid Forms used	X			Х			х			
Acknowledge receipt of all addenda	X			X			X			
Palm Beach County Contractor's Registration/License numbers or State of Florida	х			х			x			
Contractor's Certification/Registration listed on the bid form		-			***************************************			<u> </u>		
Bid amount(s) match and free of computational errors (any such errors must be noted) requires any clarifications (any such clarifications must be noted)	х			X	***************************************		Х			
ls the Bidder Responsible:										
The bidder must have adequate financial resources to perform the contract, or the ability to obtain them, necessary to indicate its capability to meet all contractual requirements.										
Bid used PBC Bid Bond Form	X	7	Г Т	Х		1	X		T	
Bid Security Amount 5%	X −			X			X			
Certified Power of Attorney with Bid Bond	X			Х			X			
Surety licensed to operate in FL & bonding limit acceptable	Х			X	***************************************		Х		İ	
The bidder must have a satisfactory record of integrity and business ethics including satisfactory compliance with laws related to taxes, labor and employment, environment, antitrust, and consumer protection										
GC is suspended from doing business with State of FL		X			Х			Х		
Subs suspended from doing business with State of FL		X			Х			Х		
GC Delinquent on Local PBC Business Tax (See PPM CW-F-056 pg 3 #38)		X			Х			X		
GC is a Scrutinized Company with State of FL		X			Х			Х		
Subs are a Scrutinized Company with State of FL	. L	<u> </u>			Х			Х	ļ	
The capacity to legally contract with the County	1									
Properly signed and notarized by the person or persons legally authorized to bind the Bidder to a contract	х			х			х			
GC registered as a vendor with PBC	<u> </u>	X			Х		X			
Vendor	_#	1 ~	L		7.				L	
Contractor's FEIN		4124205	56		528858	70	7	5316346	66	
Is Contractor's FEIN active	X	T		X			х			
State License #	·	C15186	571	C	GC1520	074	C	GC0618	08	
Supplied all necessary information in connection with the inquiry concerning responsibility, including but not limited to any licenses, permits, or organization papers required:							•			
License Check Each bidder, and all identified subcontractors, must be properly certified and										
icensed in the State of Florida and/or Paim Beach County, as applicable, for the										
purpose of performing the specified work.	Yes	No	N/A	Yes	No	N/A	Yes	No	N/A	
GC properly licensed with State of FL	Х			Х			Х			
GC registered/enrolled with PBC/PZ&B Contractor Certifications		X		Х			Х			
Major Subs Licensed/Certified	X			X			Х			
SBE-M/WBE Participation										
s there SBE participation	X	l		Х			Х			
SBE participation amount (\$)		178,000	.00	1	Ö81,000	.00	\$2,	230,700	.00	
SBE participation %*		17.83%			14.88%			15.92%	1	
	* P II							اد ما الاد ما	h 00D	
Local Preference		amount	s and per	, ,	articipati	on to be re		verified	Dy OSB/	
Certification of Business Location - Is bidder eligible for Local Preference? Has Business/Contractor submitted a valid business tax receipt with bid?	X			X			X	-		
Adjusted Bid Based on Local Preference		201,200	100		,287,07	2.05		,314,250	3 00	
MINION DIE DEGGE UN EDGE : TOTOTOTOG	<u>φ13,</u>			ं कार	,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,		413	, - , -, 250		

Tish Fox

From: Sent:

Michael W. Jones [MJones@pbogov.org] Thursday, November 21, 2013 9:59 AM Tish Fox Steve McGrew; Maurice Tobon; Brian Shields RE: Bid Revelw comments

To: Co: Subject:

As discussed, it appears that Attachment 4 was not clear regarding which pump suppliers were to be listed. As Division 11 of the Specs contains different specifications for pumps that may be considered transfer pumps (Vertical Turbine Pumps 11312D) and backwash pumps (11312K), it appears that the three low bidders only partially completed this section on Attachment 4. It is my opinion that this is a minor irregularity that may be waived, as it does not appear to affect price nor give any of the bidders a competitive advantage. The awardee will be expected to comply with the specifications regarding pump manufacturers.

From: Tish Fox [mailto:TFox@obcwater.com] Sent: Thursday, November 21, 2013 8:24 AM To: Michael W. Jones Cc: Steve McGrew; Maurice Tobon; Brian Shlelds Subject: Bid Revelw comments

Attached are the bid review comments for WUD 12-066.

Thanks, Tish

Under Florida law, e-mail addresses are public records. If you do not want your e-mail address released in response to a public records request, do not send decironic mail to and sending, instead, contect his office by phone or at writing.



Office of Small Business Assistance

50 South Military Trail, Suite 202 West Palm Beach, FL 33415 (561) 616-6840 Fax: (561) 616-6850 www.pbcgov.com/osba

> Palm Beach County Board of County Commissioners

Steven L. Abrams, Mayor

Priscilla A. Taylor, Vice Mayor

Hal R. Valeche

Paulette Burdick

Shelley Vana

Mary Lou Berger

Jess R. Santamaria

County Administrator

· Robert Weisman

"An Equal Opportunity Affirmative Action Employer"

printed on recycled paper

DATE:

November 18, 2013

TO:

Tish Fox

WUD Engineering Division

THROUGH:

Allen Gray, Manager

Office of Small Business

xicia Wilhelm, Small Business Development FROM: pecialist II

Compliance Review on Project No. WUD 12-066 SUBJECT:

Water Treatment Plant 2 Filter Replacement

The following is a Compliance Review of SBE participation

on the above-mentioned project.

Low Bidder:

MWH Constructors, Inc.

100 S. Dixie Hwy Ste 300 West Palm Beach, FL 33401

Phone:

Goal:

954-605-6711

Bid Opening:

November 1, 2013 \$13,896,000.00

Bid Amount:

15% Overall

Goal Achieved:

17.83%

SBE Participation:

(BL) Brown & Brown

\$ 1,563,000.00

11.25%

(WB) Dejong Construction

915,000.00

6.58%

\$2,478,000.00

17.83%



Page 2.

2nd Low'Bidder:

Kerlin Florida LLC

3125 W. Commercial Blvd Ste 200

Ft Lauderdale, FL 33309

Phone:

954-739-8100 \$13,986,399.00

Bid Amount:

15% Overall

Goal:

Goal Achieved:

14.87%

SBE Participation:

(SB) Proshell Construction \$2,081,000.00

14.87%

3rd Low Bidder:

Poole & Kent of Fl.

801 Northpoint Parkway Ste 64

West Palm Beach, Fl. 33407

Phone:

305-325-1930

Bid Amount:

\$14,015,000.00

Goal:

15% Overall

Goal Achieved:

15.9%

SBE Participation:

600,700.00 4.28 % (SB) Coral Steel .57 % 80,000.00 (SB) Airtex \$ 1.07 % \$ 150,000.00 (SB) Fl. Blacktop \$1,400,000.00 % 9.98 % (BL) Brown & Brown

> \$ 2,230,700.00 15.9 %



Page 3.

EVALUATION:

The Low Bidder, MWH Constructors, Inc. has met the SBE goal for this project.

The second low bidder, Kerlin Florida, LLC did not meet the SBE goal for this project.

The third low bidder, Poole & Kent of Fl., has met the SBE goal and is within the range of ranking of responsive bidders.

c: Allen Gray, Manager OSBA Tammy Fields, Chief Assistant County Attorney

Tish Fox

From: Sent:

Michael W. Jones [MJones@pbcgov.org]
Thursday, November 21, 2013 9:59 AM
Tish Fox
Steve McGrew; Maurice Tobon; Brian Shields
RE: Bid Reveiw comments

To: Co: Subject:

As discussed, it appears that Attachment 4 was not clear regarding which pump suppliers were to be listed. As Division 11 of the Specs contains different specifications for pumps that may be considered transfer pumps (Vertical Turbine Pumps 113120) and backwash pumps (11312K), it appears that the three low bidders only partially completed this section on Attachment 4. It is my opinion that this is a minor irregularity that may be waived, as it does not appear to affect price nor give any of the bidders a competitive advantage. The awardee will be expected to comply with the specifications regarding pump manufacturers.

From: Tish Fox [mailto:TFox@obcwater.com]
Sent: Thursday, November 21, 2013 8:24 AM
To: Michael W. Jones Cc: Steve McGrew; Maurice Tobon; Brian Shleids Subject: Bid Revelw comments

Attached are the bid review comments for WUD 12-066.

Thanks, Tish

Under Florida law, e-mail addresses are public records. If you do not went your e-mail address released in response to a public records request, do not send electronic mail to the entity. Instead, contect this office by phone or at writing.

Bid Review Comments

WTP 2 Filter Replacement

WUD 12-066

The three (3) lowest bids of the five (5) received for the WTP 2 Filter Replacement have been reviewed. The errors, omissions or irregularities found have been noted below.

MWH Constructors, Inc.

 Attachment No. 4 - Div 11 / Transfer & Backwash Pump Supplier - the transfer pump was not stated.

Kirlin Florida, LLC

Attachment No. 4 - Div 11 / Transfer & Backwash Pump Supplier listed "F.B. Leopole MTS
 Environmental" and Div 13 / Filter System Supplier listed "Flowserve Carter & VerPlanck" these appear to have been transposed. Also the backwash recovery pump was not stated.

Poole & Kent Company of Florida

 Attachment No. 4 - Div 11 / Transfer & Backwash Pump Supplier - the backwash recovery pump was not stated.

WUD 12-066 Page 1 of 1